

DAT 9011-DL



FEATURES

- N°1 serial interface RS-485 Modbus RTU Master
- N°1 serial interface RS-485/232 Modbus RTU Slave
- N°1 Slot for microSD card
- Interface Ethernet 10Base-T, Modbus TCP Server
- N°1 universal analogue input + N°1 current and voltage analogue input
- N°2 digital Inputs
- Auxiliary supply to power sensors on field
- N°2 passive 4-20 mA analogue outputs
- N°2 SPDT Relay Outputs
- Functional Block programming software
- Remotely programmable
- Connection by removable screw-terminals
- LED signalling for Link/Act Ethernet, serial RX-TX, power supply
- LED signalling for digital inputs and digital outputs state
- Galvanic Isolation on all the ways
- EMC compliance – CE mark
- Suitable for DIN rail mounting in compliance with EN-50022 standard

GENERAL DESCRIPTION

The device DAT9011-DL is an Intelligent unit able to control a network of slave Modbus RTU devices connected on serial line RS-485 Master executing the reading and writing of the field values and performing the logical and mathematical functions necessary for the system working and managing up to 8 tasks of storage data. The data are saved on microSD card; it is possible to get access to the saved files by means of the Ethernet connection .

The device is equipped with one universal analogue input channel, one channel for Volt and mA input, two digital inputs and 2 relay outputs .

On input an Auxiliary source is available to supply passive sensors on the field. By means of the Ethernet interface or the RS-485 "SLAVE" or RS-232 ports it is possible to read and write, in real time, the internal registers value. Moreover, by means of the Ethernet interface, or by the RS-485 "SLAVE" or RS-232 ports it is possible to program the Control Logic, to monitor, to request data and programming in real time the Intelligent Unit, to program directly the Slave devices connected on the RS-485 Master and to request data from them. The device DAT9011-DL is configurable by the software *DEV9K* developed by DATEXEL and running under Windows. The LED of signalling of Ethernet activity and data rx-tx flow on the serial line allows a direct monitoring of the system functionality. The connection is made by removable screw-terminals (supply and RS-485) and RJ45 plug (Ethernet and RS-232). The device DAT9011-DL realizes a full electrical isolation between the lines, introducing a valid protection against the effects of all ground loops eventually existing in industrial applications. The device is housed in a rough self-extinguishing plastic enclosure which, thanks to its thin profile of 22.5 mm only, allows a high density mounting on EN-50022 standard DIN rail.

TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in the nominal conditions)

INPUT			Input Impedance		Serial Ports RS-485 (Master & Slave)		
Input type	Min	Max	mV, TC	10 MΩ	Protocol	Modbus RTU	
Voltage			Volt	1 MΩ	Baud Rate	up to 115200 bps	
100 mV	-100 mV	100 mV	mA	22 Ω	Max. recommended distance (3)	1.2 Km @ 38.4 Kbps	
10 Volt	-10 V	10 V	Thermal Drift (1)		Number of modules in multipoint	32 max.	
TC			Inputs - Full Scale	± 0.01 % / °C	Internal termination resistance (optional)	120 Ohm (optional)	
J	-210°C	1200°C	Thermal Drift CJC		POWER SUPPLY		
K	-210°C	1370°C	Full Scale	± 0.02 °C/ °C	Supply voltage	9 ÷ 30 Vdc	
R	-50°C	1760°C	Sample time	1 sec.	Current cons. @ 24 V	60 mA (170 mA max)	
S	-50°C	1760°C	Warm-up time	3 minutes	Current cons. @ 10 V	147 mA (300 mA max)	
B	400°C	1825°C	OUTPUT (2 channels)		Polarity rev. protection	60 Vdc max.	
E	-210°C	1000°C	Output type	Min	Max		
T	-210°C	400°C	Current	4 mA	20 mA	ISOLATION	
N	-210°C	1300°C	Accuracy (2)	± 0.05 % f.s.		1500 Vac, 50 Hz, 1 min	
RTD 2,3 wires			Linearity (2)	± 0.05 % f.s.		CONNECTIONS	
Pt100	-200°C	850°C	Thermal Drift (2)	± 0.01 % / °C		Ethernet	RJ-45 (on term. side)
Pt1000	-200°C	200°C	Load resistance	see "Load Characteristic"		RS-232D	RJ-45 (on front side)
Ni100	-60°C	180°C	DIGITAL INPUTS			RS-485 Master / Slave	Screw term. 5.08mm
Ni1000	-60°C	150°C	Number of Channels	2		Relay Outputs	Screw term. 5.08mm
Resistance 2,3 wires			Input voltage	OFF State : 0÷3 V		Supply/In/Analogue out	Screw term. 3.81mm
Low	0 Ω	500 Ω	(bipolar)	ON State : 10÷30 V		ENVIRONMENTAL CONDITIONS	
High	0 Ω	2000 Ω	Input Impedance	4.7 Kohm		Operative Temperature	-20°C .. +60°C
Potentiometer			DIGITAL OUTPUTS			Storage Temperature	-40°C.. +85°C
	20 Ω	2000 Ω	N.2 Relays SPDT			Humidity (not condensed)	0 .. 90 %
Current			Maximum switching power per contact (resistive load)	2 A @ 250 Vac		Maximum Altitude	2000 m
20 mA	-20 mA	20 mA		2 A @ 30 Vdc		Installation	Indoor
Accuracy (1)			Minimum load	5Vdc, 10mA		Category of installation	II
mV, Volt, mA	± 0.05 % f.s.		Max. voltage	250Vac (50 / 60 Hz) , 110Vdc		Pollution Degree	2
Pot, RTD, Res.	± 0.05 % f.s.		DIELECTRIC STRENGTH			MECHANICAL SPECIFICATIONS	
TC	> ± 0.05 % f.s. or 5 uV		Dielectric Strength between contacts	1000 Vac, 50 Hz, 1 min.		Material	Self-extinguish plastic
Linearity (1)			Dielectric Strength between coil and contacts	4000 Vac, 50 Hz, 1 min.		IP Code	IP20
mV, Volt, mA	± 0.05 % f.s.		In compliance with Ethernet IEEE 802.3 EIA RS485 and RS232			Wiring	wires with diameter 0.8÷2.1 mm ² /AWG 14-18
Pot, RTD, Res.	± 0.1 % f.s.		Network interface	Ethernet 10/100Base-T		Tightening Torque	0.5 N m
TC	± 0.2 % f.s.		Protocol	Modbus TCP Server		Mounting	in compliance with DIN rail standard EN-50022
RTD, Res, Pot excitation current			Compatible SD card			Weight	about 190 g.
Typical	0.400 mA		Type	microSD		CERTIFICATIONS	
Lead wire resistance influence			Memory size	Up to 16 GB		EMC (for industrial environments)	
RTD/Res 3 wires(50 Ω max balanced)	0.05 f.s. %/Ω		Format	FAT16 or FAT32		Immunity	EN 61000-6-2
mV, Tc	< 0.8 uV/Ohm		NOTES:			Emission	EN 61000-6-4
CJC Compensation error			(1) Referred to input Span (difference between max. and min. values)				
Auxiliary voltage	> 14 Vdc @ 20 mA		(2) Referred to output Span (difference between max. and min. values)				
			(3) – The maximum distance depends of: number of devices connected, type of cabling, noises, etc...				

LIST OF SUPPORTED FUNCTION

- Communication:
- Read data from "slave" devices (Modbus function 04)
 - Write data to "slave" devices (Modbus function 16)
- Logical:
- Boolean(And, Or,)
 - Compare (>, <, =,)
 - Arithmetical (Sum, Subtraction, Multiplication, Division)
 - Calculation (Scaling, Exponential functions, Square root extraction, Arithmetic mean,)
- Process:
- Conditional statements (IF)
 - Flow control (Goto, Call,)

For the complete list of functions and their operation, refer to the Programming software User Guide.

INSTALLATION INSTRUCTIONS

The Intelligent Unit DAT9011-DL is suitable for fitting to DIN rails in the vertical position.

For optimum operation and long life follow these instructions:

When the devices are installed side by side it may be necessary to separate them by at least 5 mm in the following case:

- If panel temperature exceeds 35°C
- power supply value < 15 Vdc.

Make sure that sufficient air flow is provided for the device avoiding to place raceways or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel.


Install the device in a place without vibrations.

Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters, etc...) and to use shielded cable for connecting signals.

LIGHT SIGNALLING

LED	COLOR	STATE	DESCRIPTION
PWR	GREEN	ON	Device powered
		OFF	Device not powered / Wrong RS-485 connection
STS	YELLOW	BLINK	DEBUG modality
		OFF	RUN modality
RX <i>n</i>	RED	BLINK	PORT <i>n</i> - Data received (the blink frequency depends on Baud-rate)
		OFF	No reception in progress.
TX <i>n</i>	RED	BLINK	PORT <i>n</i> - Data transmitted (the blink frequency depends on Baud-rate)
		OFF	No reception in progress.
I <i>n</i>	RED	ON	State 1 Digital Inputs.
		OFF	State 0 Digital Inputs.
O <i>n</i>	RED	ON	State 1 Digital Outputs.
		OFF	State 0 Digital Outputs.


MECHANICAL DIMENSIONS (mm)

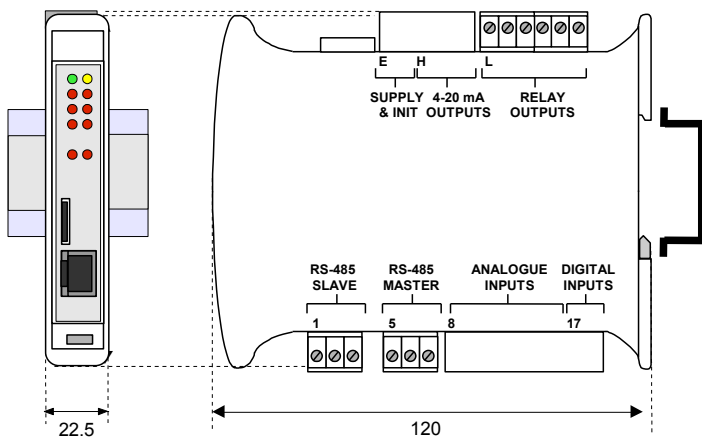

LOAD CHARACTERISTIC

Rload: express the value of load in the current loop and it is calculated as function of the power supply value of the output loop.

The 4+20 mA output signal is measurable in series to the output loop as shown in the section "Analogue output connection"; Rload is the input impedance of the instruments on the loop; to obtain a correct measure it is recommended that the maximum value of Rload will be calculated in function of the value of loop supply voltage.

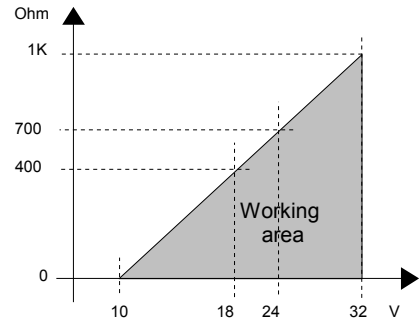

MODBUS REGISTERS MAPPING

Register	Description	Access
%R0	--Reserved--	R/W
%R1	Firmware [0]	R
%R2	Firmware [1]	R
%R3	Name [0]	R/W
%R4	Name [1]	R/W
%R5	Port 1 [BaudRate]	R/W
%R6	Node ID	R/W
%R7	Port 1 [Timeout RX]	R/W
%R8	Digital Inputs	R/W
%R9	Digital Outputs	R/W
%R10	System Flags	R/W
%R11	--Reserved--	-
%R12	--Reserved--	-
%R13	PC	R
%R14	Status [0]	R
%R15	Status [1]	R
%R16	COM Errors	R/W
%R17	Gateway Mask [L-H]	R/W
%R18	Port 0 [Settings]	R/W
%R19	Port 2 [Settings]	R/W
%R20	Timers Enable	R/W
%R21	--Reserved--	-
%R22	--RTC(0)	R/W
%R23	--RTC(1)	R/W
%R24	--RTC(2)	R/W
%R25	--RTC(3)	R/W
%R26	Analogue input ch. 0	R
%R27	Analogue input ch. 1	R
%R28	--Reserved--	-

%R31		
%R32	Analogue output ch. 0	R/W
%R33	Analogue output ch. 1	R/W
%R34	Program. sensor ch. 0 & 1	R/W
%R35	"General Purpose" Registers	R/W

%R927		
%R928	Frequency Digital input 0	R
%R929	Frequency Digital input 1	R
%R930	--Reserved--	-
%R931	--Reserved--	-
%R932-933	Counter Digital input 0	R/W
%R934-935	Counter Digital input 1	R/W
%R936	--Reserved--	-

%R940		
%R941	"General Purpose" Registers	R/W

%R959		
%R960	Retentive Registers	R/W

%R1023		

MicroSD card HANDLING

Warning: execute this operation only if necessary; to get access to the data on the card it is suggested, if possible, to use the Ethernet interface.

Insertion and removing

Power off the device.

Open the plastic door located on the front of the device.

Insert the card into the slot in the correct way and push the card to block it inside the connector; to extract the card, push slightly the card on the border to unblock the connector and pull out the card.


Close the plastic door located on the front of the device.

Power-on the device.


CONNECTIONS

SERIAL PORTS CONNECTION


RS-232D SLAVE (PORT 0)

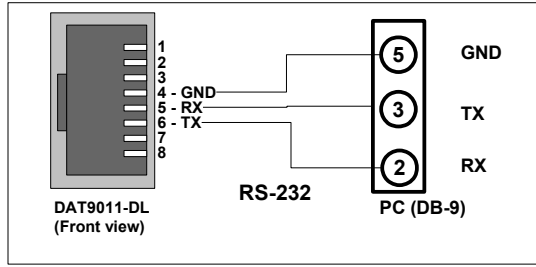


RS-485 SLAVE (PORT 0)

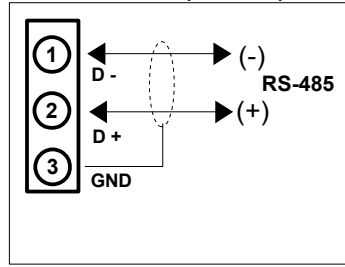

RS-485 MASTER (PORT 1)

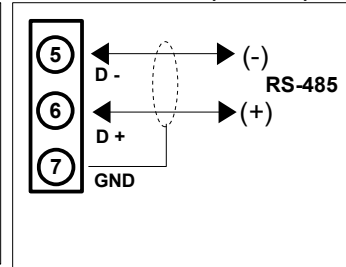


MICRO SDCARD




ANALOGUE INPUTS CONNECTION

CHANNEL 0 - UNIVERSAL INPUT

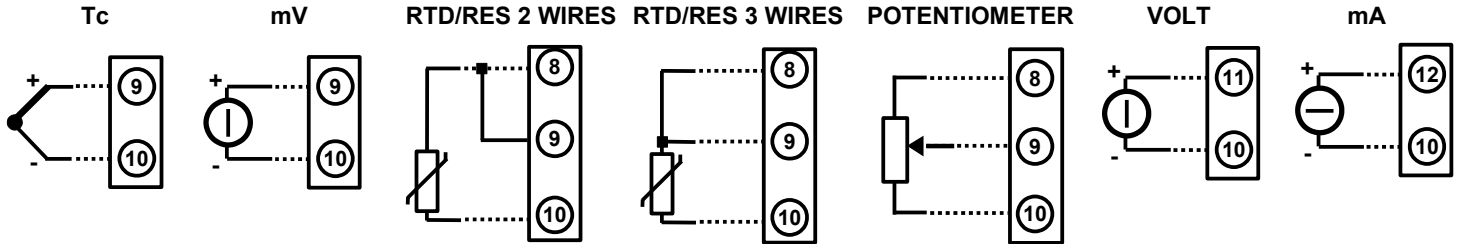


CHANNEL 1 - VOLT / mA INPUT

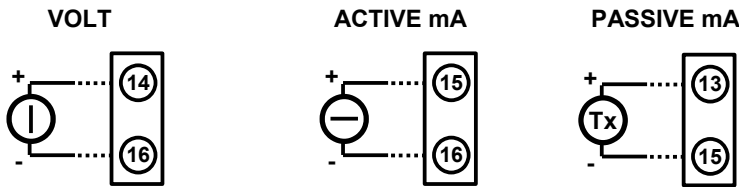


NOTE: the analogue input channels are not isolated between them.

DIGITAL INPUTS CONNECTION

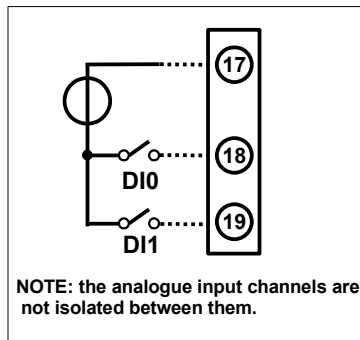


NOTE: the analogue input channels are not isolated between them.


RELAY OUTPUTS CONNECTION

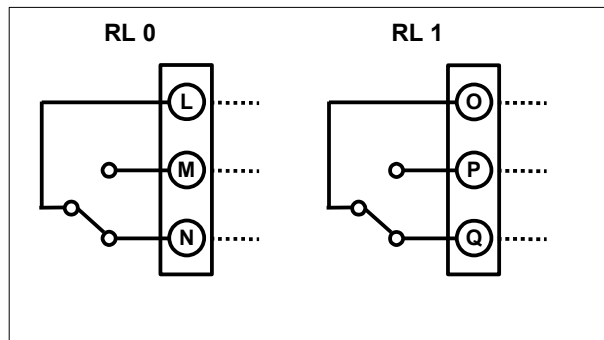


POWER SUPPLY CONNECTION

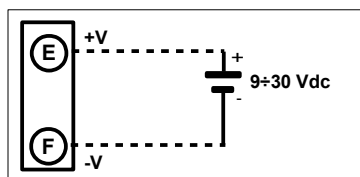

INIT CONNECTION

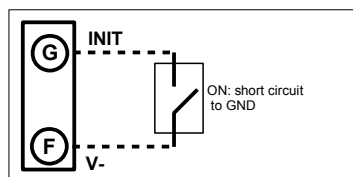

ANALOGUE OUTPUT CONNECTION

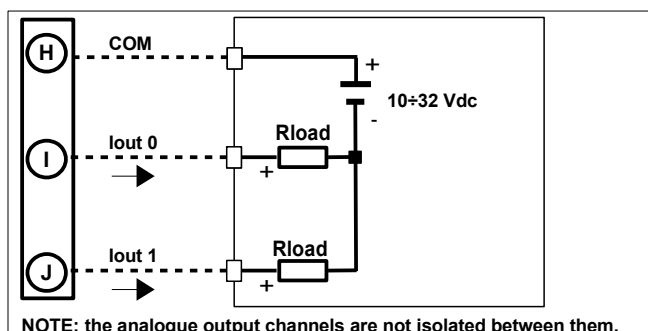

NOTE: the analogue output channels are not isolated between them.

HOW TO ORDER

“ DAT 9011-DL “