



FEATURES

- Field-Bus remote data acquisition
- Modbus Slave device on RS-485
- Modbus RTU/ Modbus ASCII protocol
- 8 channel output
- Outputs configurable as Voltage
- Watch-Dog Alarm
- Remotely Configurable
- 2000 Vac 3-ways Galvanic Isolation
- High Accuracy
- UL / CE mark
- DIN rail mounting in compliance with EN-50022



GENERAL DESCRIPTION

The DAT 3028 device generates 8 output analog signals from digital commands. The data are transmitted with MODBUS RTU/MODBUS ASCII protocol on the RS-485 network (RS-232 interface is available). It is possible to generate voltage signals up to 10V. The device guarantees high accuracy and stable measure versus time and temperature. To ensure the plant safety, two Watch-Dog timer alarms are provided. The isolation between the parts of circuit removes eventual ground-loop effects, allowing the use of the device even in the heavy environmental conditions. The DAT 3028 is in compliance with the Directive UL 61010-1 for US market and with the Directive CSA C22.2 No 61010-1 for the Canadian market. The device is housed in a rough self-extinguishing plastic container which, thanks to its thin profile of 17.5mm only, allows a high density mounting on EN-50022 standard DIN rail.

COMMUNICATION PROTOCOLS

The DAT3028 is designed to work with the MODBUS RTU/MODBUS ASCII protocol: standard protocol in field-bus; allows to directly interface DAT3000 series devices to the larger part of PLCs and SCADA applications available on the market. For the protocol instructions, refer to the User Guide of the device.

USER INSTRUCTIONS

Before to install the device, please read the "Installation Instruction" section. If the module configuration is unknown, with device powered off, connect the INIT terminal to the GND terminal (ground), at the next power on the device will be auto-configured in the default settings (refer to the User Guide of the device). Connect power supply, serial bus and analogue outputs as shown in the "Wiring" section. The "PWR" LED state depends on the working condition of the device: see the "Light Signalling" section to verify the device working state. To perform configuration and calibration operations, read the instructions in the User Guide of the device. To simplify handling or replacing of the device, it is possible to remove the wired terminals even with the device powered.

TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in the nominal conditions)

OUTPUT (8 channels)			Output Accuracy		POWER SUPPLY																													
Output type	Min	Max	Voltage	± 10 mV	Power supply voltage	18 .. 30 Vdc																												
Voltage Volt	0 V	+10 V	Thermal drift Full scale	± 0.01 % / °C	Current consumption	Reverse polarity protection	60 Vdc max																											
						30 mA max.																												
<table border="1"> <thead> <tr> <th>Value</th> <th>V/s</th> </tr> </thead> <tbody> <tr><td>00h</td><td>Disabled</td></tr> <tr><td>01h</td><td>0.15</td></tr> <tr><td>02h</td><td>0.30</td></tr> <tr><td>03h</td><td>0.60</td></tr> <tr><td>04h</td><td>1.20</td></tr> <tr><td>05h</td><td>2.40</td></tr> <tr><td>06h</td><td>4.80</td></tr> <tr><td>07h</td><td>9.60</td></tr> <tr><td>08h</td><td>19.2</td></tr> <tr><td>09h</td><td>38.4</td></tr> <tr><td>0Ah</td><td>76.8</td></tr> <tr><td>0Bh</td><td>153</td></tr> <tr><td>0Ch</td><td>Immediate</td></tr> </tbody> </table>			Value	V/s	00h	Disabled	01h	0.15	02h	0.30	03h	0.60	04h	1.20	05h	2.40	06h	4.80	07h	9.60	08h	19.2	09h	38.4	0Ah	76.8	0Bh	153	0Ch	Immediate	ISOLATION On all the ways	2000 Vac, 50 Hz, 1 min	ENVIRONMENTAL CONDITIONS	
			Value	V/s																														
			00h	Disabled																														
			01h	0.15																														
			02h	0.30																														
			03h	0.60																														
			04h	1.20																														
			05h	2.40																														
			06h	4.80																														
			07h	9.60																														
			08h	19.2																														
			09h	38.4																														
			0Ah	76.8																														
			0Bh	153																														
			0Ch	Immediate																														
Operative Temperature		-10°C .. +60°C																																
UL Operative Temperature		-10°C .. +40°C																																
Storage Temperature		-40°C.. +85°C																																
Humidity (not condensed)		0 .. 90 %																																
Maximum Altitude		2000 m																																
Installation		Indoor																																
Category of installation		II																																
Pollution Degree		2																																
			MECHANICAL SPECIFICATIONS		Material		Self-extinguish plastic																											
			IP Code		IP20		Wiring		wires with diameter 0.8÷2.1 mm ² /AWG 14-18																									
			Tightening Torque		0.5 N m		Mounting	in compliance with DIN rail standard EN-50022																										
			Weight		about 150 g.																													
			Data Transmission		CERTIFICATIONS		EMC (for industrial environments)																											
			Baud Rate		115.2 Kbps		Immunity		EN 61000-6-2																									
Max. distance		1.2 Km – 4000 ft		Emission		EN 61000-6-4																												
					UL		US Standard		UL 61010-1																									
					Canadian Standard		CSA C22.2 No 61010-1																											
					CCN		NRAQ/NRAQ7																											
					Typology		Open Type device																											
					Classification		Industrial Control Equipment																											
					File Number		E352854																											

INSTALLATION INSTRUCTIONS

The DAT 3028 is suitable for fitting to DIN rails in the vertical position. For optimum operation and long life follow these instructions:

When the devices are installed side by side it may be necessary to separate them by at least 5 mm in the following case:

- If panel temperature exceeds 45°C and at least one of the overload conditions exist.


The overload conditions are the following:

- High supply voltage: >27Vdc

Make sure that sufficient air flow is provided for the device avoiding to place raceways or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel. Install the device in a place without vibrations.

Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters etc...) and to use shielded cable for connecting signals.


CABLING

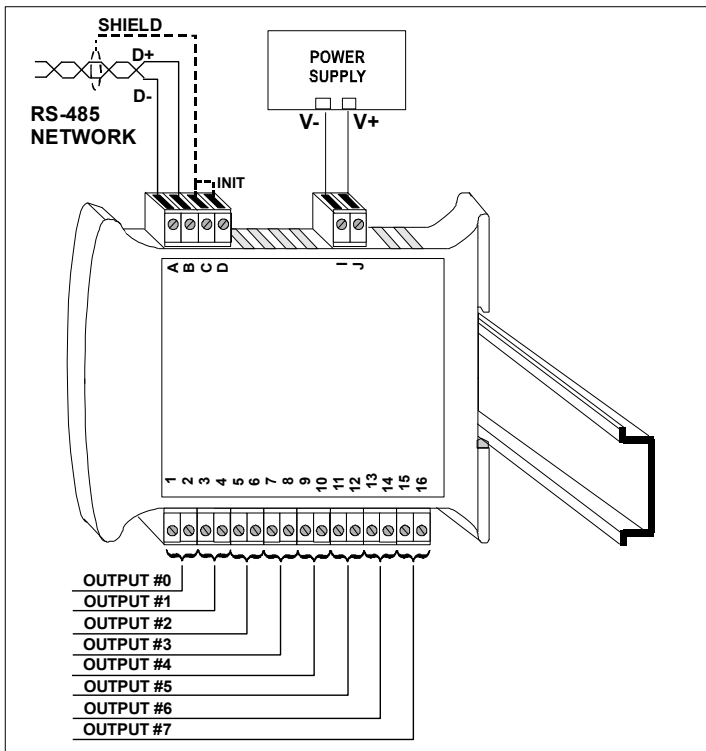

LIGHT SIGNALLING

LED	COLOUR	STATE	DESCRIPTION
PWR	GREEN	ON	Device powered
		OFF	Device not powered / Wrong RS-485 cabling.
		FAST BLINK	Communication in progress (blink frequency depends to baud-rate)
		1 second BLINK	Watch-Dog Alarm condition


MECHANICAL DIMENSIONS (mm)

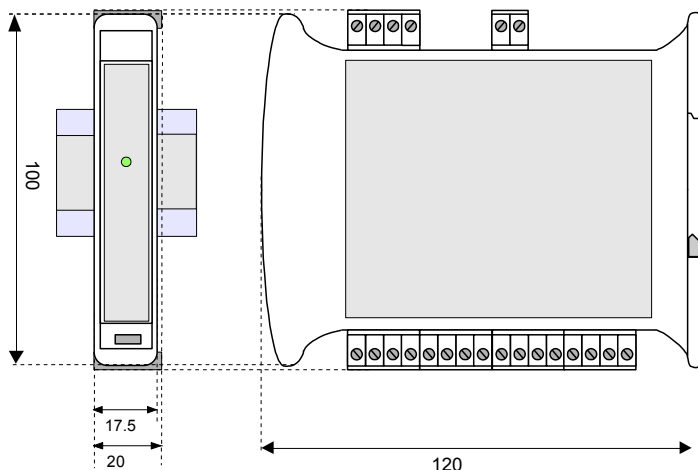

WIRING


ANALOG OUTPUTS

VOLTAGE

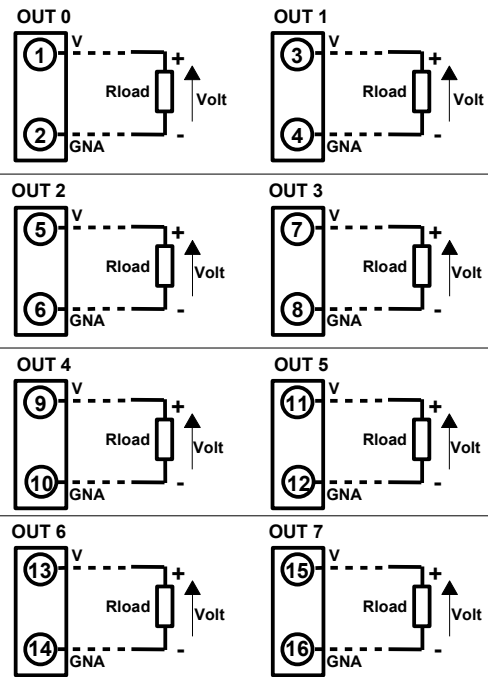


Note: the output channels are not isolated between them. Terminals GNA of channels connected between them.


RS-485 NETWORK

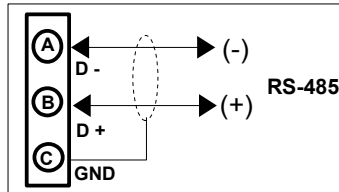


RS-232 NETWORK

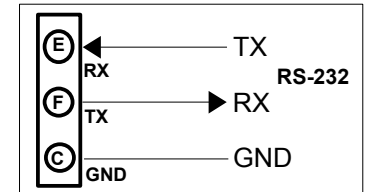

POWER SUPPLY (*)

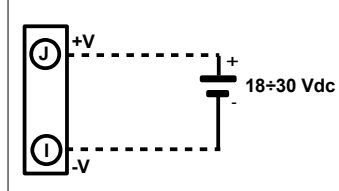

INIT

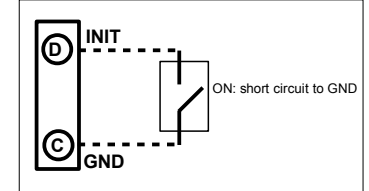

(*) Note: for UL installation the device must be powered using a power supply unit classified NEC class 2 or SELV

(**) Note: for RS232 version INIT and GND are inverted between them

ISOLATION STRUCTURE



HOW TO ORDER

In the order phase, it is mandatory to specify the interface type (RS485 or RS232). DAT3028 can be supplied with the configuration specified by the customer.

ORDER CODE:

DAT 3028 / 485

Interface type
485 : RS-485
232 : RS-232

■ = Requested
□ = Optional