



## FEATURES

- Configurable input for RTD, TC, mV, V, mA, Resistance and Potentiometer
- Galvanic isolation at 2000 Vac on the 3 ways
- Configurable output in current or voltage
- Configurable by Personal Computer
- High accuracy
- On-field reconfigurable
- EMC compliant – CE mark
- Suitable for DIN rail mounting in compliance with EN-50022 and EN50035



## GENERAL DESCRIPTION

The converter DAT 4235 is able to execute many functions such as : measure and linearisation of the temperature characteristic of RTDs sensors, conversion of a linear resistance variation, conversion of a standard active current signal, conversion of a voltage signal even coming from a potentiometer connected on its input. Moreover the DAT 4235 is able to measure and linearise the standard thermocouples with internal cold junction compensation. In function of programming, the measured values are converted in a current or voltage signal. The device guarantees high accuracy and performances stability both in time and in temperature.

The programming of the DAT 4235 is made by a Personal Computer using the software PROSOFT, developed by DATEXEL, that runs under the operative system "Windows™". By use of PROSOFT, it is possible to configure the converter to interface it with the most used sensors.

In case of sensors with a no-standard output characteristic, it is possible to execute, via software, a "Custom" linearisation (per step) to obtain an output linearised signal.

For Resistance and RTDs sensors it is possible to program the cable compensation with 3 or 4 wires; for Thermocouples it is possible to program the Cold Junction Compensation (CJC) as internal or external.

It is possible to set the minimum and maximum values of input and output ranges in any point of the scale, keeping the minimum span shown in the table below. Moreover it is available the option of alarm for signal interruption (burn-out) that allows to set the output value as high or low out of scale.

**The terminals of the current signal on input side must be only connected to active current loop.**

The 2000 Vac isolation between input, power supply and output eliminates the effects of all ground loops eventually existing and allows the use of the converter in heavy environmental conditions found in industrial applications.

It is housed in a plastic enclosure of 12.5 mm thickness suitable for DIN rail mounting in compliance with EN-50022 and EN-50035 standards.

## USER INSTRUCTIONS

The converter DAT 4235 must be powered by a direct voltage between 18 to 30 V applied to the terminals Q(+Vdc) and R (GND1) as shown in the section "Power supply connections".

The output signal, in voltage or current, is provided to the terminals N(OUT) and M (GND2), as shown in the section "Output connections".

The input connections must be made as shown in the section "Input connections".

To configure, calibrate and install the converter, refer to sections "DAT4235: configuration and calibration" and "Installation Instructions".

## TECHNICAL SPECIFICATIONS (Typical at 25 °C and in nominal conditions)

Input type	Min	Max	Min. span	Input calibration (1)	POWER SUPPLY
<b>TC(*) CJC int./ext.</b>				RTD > of ±0.1% f.s. or ±0.2°C	Supply voltage 18 .. 30 Vdc
J	-200°C	1200°C	100 °C	Low res. > of ±0.1% f.s. or ±0.15 Ω	Reverse polarity protection 60 Vdc max
K	-200°C	1370°C	100 °C	High res. > of ±0.2% f.s. or ±1 Ω	
S	-50°C	1760°C	400 °C	mV, TC > of ±0.1% f.s. or ±18 uV	<b>Current consumption</b>
R	-50°C	1760°C	400 °C	Volt > of ±0.1% f.s. or ± 2 mV	Current output 70 mA max.
B	400°C	1820°C	400 °C	mA > of ±0.1% f.s. or ± 6 uA	Voltage output 50 mA max.
E	-200°C	1000°C	100 °C	<b>Output calibration</b>	<b>Output Load Resistance (Rload)</b>
T	-200°C	400°C	100 °C	Current ± 7 uA	Current output ≤ 650 Ω
N	-200°C	1300°C	100 °C	Voltage ± 5 mV	Voltage output ≥ 600 Ω
<b>RTD(*) 2,3,4 wires</b>				<b>Input impedance</b>	Limitation current about 30 mA
Pt100	-200°C	850°C	50°C	TC, mV ≥= 10 MΩ	
Pt1000	-200°C	200°C	50°C	Volt ≥= 1 MΩ	<b>ISOLATION</b>
Ni100	-60°C	180°C	50°C	Current ~ 50 Ω	On all the ways 2000 Vac, 50 Hz, 1 min.
Ni1000	-60°C	150°C	50°C	<b>Linearity (1)</b>	<b>ENVIRONMENTAL CONDITIONS</b>
<b>Voltage</b>				TC ± 0.2 % f.s.	Operative Temperature -20°C .. +70°C
mV	-400 mV	+400 mV	2 mV	RTD ± 0.1 % f.s.	Storage Temperature -40°C.. +85°C
mV	-100 mV	+700 mV	2 mV	<b>Line resistance influence</b>	Humidity (not condensed) 0 .. 90 %
Volt	- 10 V	+10 V	500 mV	TC, mV ≤=0.8 uV/Ohm	Maximum Altitude 2000 m
<b>Potentiometer</b>				RTD 3 wires 0.05%/Ω (50 Ω balanced max.)	Installation Indoor
(Nominal value)	0 Ω	200 Ω	10%	RTD 4 wires 0.005%/Ω (100 Ω balanced max.)	Category of installation II
	200 Ω	500 Ω	10%	<b>RTD excitation current</b>	Pollution Degree 2
	0.5 KΩ	50 KΩ	10%	Typical 0.350 mA	<b>MECHANICAL SPECIFICATIONS</b>
<b>RES. 2,3,4 wires</b>				<b>CJC comp.</b> ± 0.5°C	Material Self-extinguish plastic
Low	0 Ω	300 Ω	10 Ω	<b>Thermal drift (1)</b>	IP Code IP20
High	0 Ω	2000 Ω	200 Ω	Full scale ± 0.01% / °C	Wiring wires with diameter 0.8±2.1 mm <sup>2</sup> /AWG 14-18
<b>Current</b>				CJC ± 0.01% / °C	Tightening Torque 0.8 N m
mA	-10 mA	+24 mA	2 mA	<b>Burn-out values</b>	Mounting in compliance with DIN rail standard EN-50022 and EN-50035
<b>Output type</b>	<b>Min</b>	<b>Max</b>	<b>Min. span</b>	Max. values about 25 mA or 10.8 Vdc	Weight about 90 g.
Direct current	0 mA	20 mA	4 mA	Min. values about -25 mA or -10.8 Vdc	<b>EMC ( for industrial environments )</b>
Reverse current	20 mA	0 mA	4 mA	<b>Response time (10÷ 90%)</b>	Immunity EN 61000-6-2
Direct voltage	0 V	10 V	1 V	about 400 ms	Emission EN 61000-6-4
Reverse voltage	10 V	0 V	1 V		

(1) referred to input Span (difference between max. and min. values)  
 (\*) For temperature sensors it is possible to set the input range also in °F; to made the conversion use the formula: °F = (°C\*9/5)+32)

## DAT 4235: CONFIGURATION AND CALIBRATION

**Warning:** during these operations the device must always be powered.

### - CONFIGURATION


- 1) Power-on the DAT4235 by a direct voltage between  $18 \div 30$  V .
- 2) Open the plastic label protection on front side of DAT 4235.
- 3) Connect the interface PRODAT to the Personal Computer and to device (connector PGRM - see section "DAT4235: PROGRAMMING" ).
- 4) Run the software PROSOFT.
- 5) Set the parameters of configuration .
- 6) Program the device.

### - CALIBRATION CONTROL


**With software PROSOFT running:**

- 1) Connect on the input a calibrator setted with minimum and maximum values referred to the electric signal or to the temperature sensor to measure.
- 2) Set the calibrator at the minimum value.
- 3) Verify that the DAT 4235 provides on output the minimum setted value.
- 4) Set the calibrator at the maximum value.
- 5) Verify that the DAT 4235 provides on output the maximum setted value.
- 6) In case of regulation of value obtained in the step 3 and 5, use the ZERO and SPAN regulators of software PROSOFT. The variation introduced from these regulators must be calculated as percentage of the input range .
- 7) Program the device with the new parameters .


## DAT 4235: PROGRAMMING

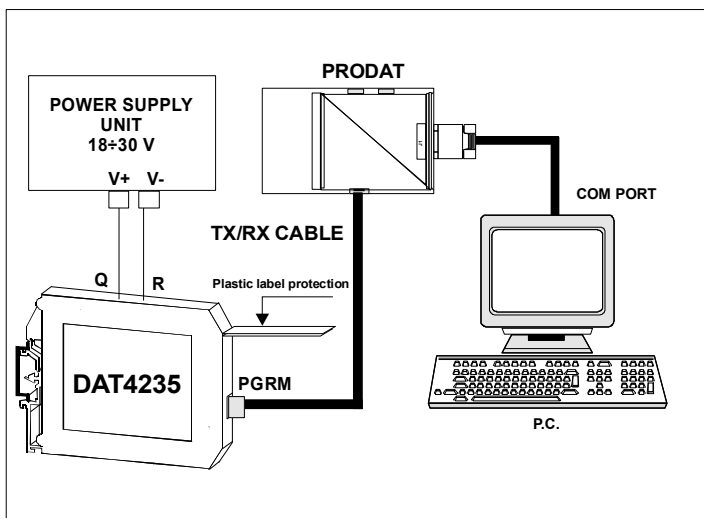

## ISOLATION STRUCTURE

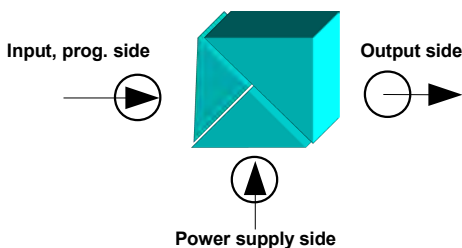

## DIMENSIONS (mm) & CONNECTOR PGRM

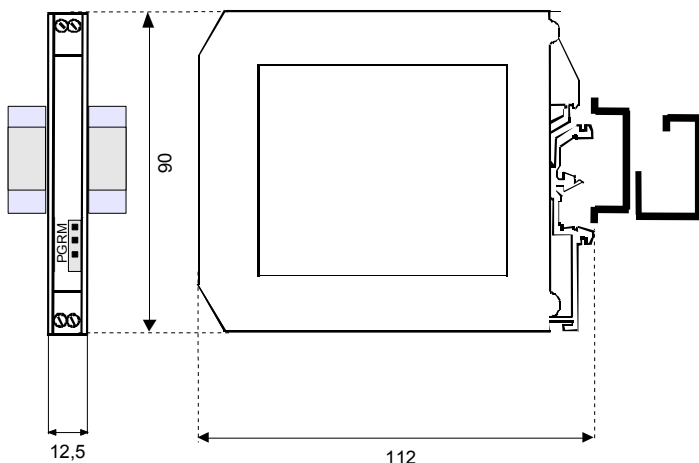


## INSTALLATION INSTRUCTIONS

The device DAT 4235 is suitable for DIN rail mounting.

It is necessary to install the device in a place without vibrations; avoid to routing conductors near power signal cables .


## DAT4235: CONNECTIONS

### INPUT CONNECTIONS

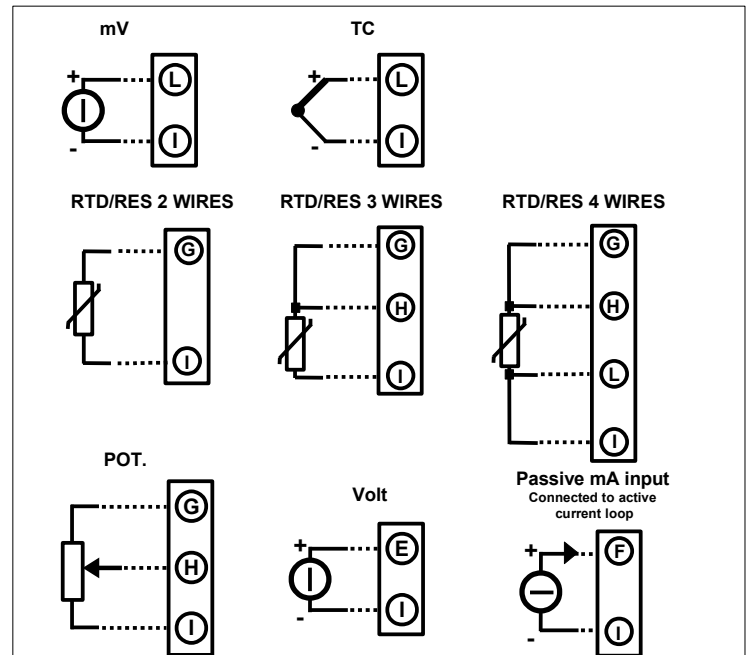


Terminal I = GND3

### POWER SUPPLY CONNECTIONS

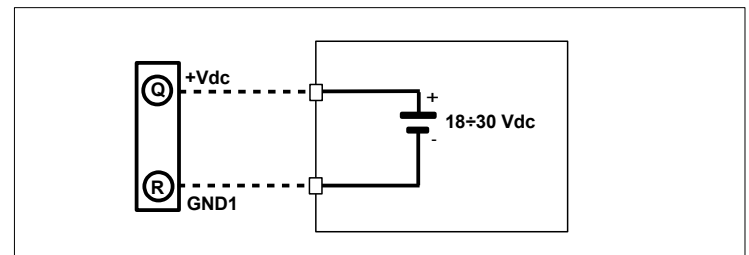

Note: terminal P = O = GND1

### OUTPUT CONNECTIONS

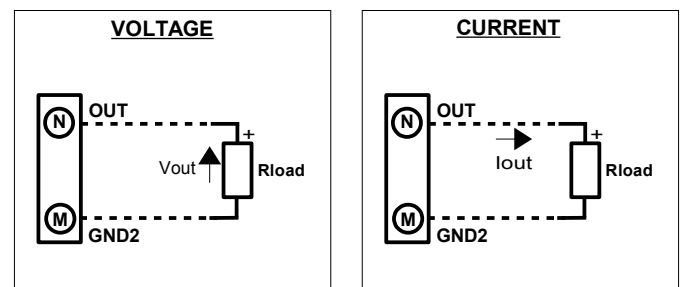

### HOW TO ORDER

The DAT4235 is provided as requested on the Customer's order. Refer to the section "Technical specification" to determine input and output ranges. In case of the configuration is not specified, the parameters must be set by the user.

### ORDER CODE EXAMPLE:

