

GENERAL DESCRIPTION

The device DAT3580-USB is an isolated interface converter between USB port and asynchronous serial lines RS485 or RS422 that guarantees a full isolation between power supply, USB and serial line RS-485 or 422 removes eventual ground-loop effects, allowing the use of the device even in the heavy environmental conditions.

It is designed to operate either on serial interface RS-422 full-duplex 4 wires or RS485 half-duplex 2 wires, with a baud-rate transmission up to 115.2 Kbps.

The transmission is asynchronous without settings of protocol, data format and baud rate.

The DAT 3580-USB is in compliance with the Directive UL 61010-1 for US market and with the Directive CSA C22.2 No 61010-1 for the Canadian market. The device is housed in a rough self-extinguishing plastic container which, thanks to its thin profile of 22.5 mm only, allows a high density mounting on EN-50022 standard DIN rail.

USER INSTRUCTIONS

Before to install the device, please read the "Installation Instruction" section.

The device DAT3580-USB converts the serial transmission from USB to RS-485 (2 wires) or RS-422 (4 wires) as follows.

The data incoming from the line TX of USB port are converted and transmitted to the terminals D-E of RS-485 and RS-422.

The data incoming from the line RX of RS-485 (terminal D and E) or RS-422 (terminal B and C) are converted and transmitted to the terminal RX of USB port. The transmission of the signal follows the logic state of every single bit, then there is not necessary to set the protocol, the data format and the baud-rate. When the data transmission from the USB is off, the RS-485 driver is in the receive condition (high impedance); when the data transmission from the USB goes on the RS-485 driver switch immediately to the transmission condition (low impedance). The low impedance is kept for about 150 us, then the line returns automatically in high impedance (receiver).

TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in the nominal conditions)

In compliance with standard		ISOLATION	
RS485 Interface Baud-rate	USB 2.0, RS485 and RS422	Power supply / USB Power supply / RS485-422 USB / RS485-422	2000 Vac, 50 Hz, 1 min. 2000 Vac, 50 Hz, 1 min. 2000 Vac, 50 Hz, 1 min.
Max. distance / baud-rate ratio (recommended) (1) Number of modules in multipoint	1.2 Km – 4000 ft @ 38400 bps 2 Km – 6560 ft @ 19200 bps 3 Km – 9840 ft @ 9600 bps 4 Km – 13100 ft @ 4800 bps 5 Km – 16400 ft @ 2400 bps 7 Km – 23000 ft @ 1200 bps up to 32	ÈNVIRONMENTAL CONDIT Operative Temperature UL Operative Temperature Storage Temperature Humidity (not condensed) Maximum Altitude Installation Category of installation Pollution Degree	IONS -20°C +60°C
Switching time TX/RX (RS485)	150 us.	MECHANICAL SPECIFICAT	
Internal terminator resistance (optional) 120 Ohm		Material IP Code Wiring	Self-extinguish plastic IP20 wires with diameter
POWER SUPPLY Power supply DC voltage Reverse polarity protection Power supply AC voltage	10 30 Vdc 60 Vdc max 9 ÷ 18 Vac (18 ÷ 30 Vac optional)	Tightening Torque Mounting Weight	0.8÷2.1 mm ² /AWG 14-18 0.5 N m in compliance with DIN rail standard EN-50022 about 160 g.
Current consumption	35 mA max.	CERTIFICATIONS EMC (for industrial enviro	nments)
Connection USB	USB connector type "A" (cable length ~ 1.8 mt.)	Immunity Emission UL US Standard	EN 61000-6-2 EN 61000-6-4
RS-485/422	removable screw terminals	Canadian Standard CCN	UL 61010-1 CSA C22.2 No 61010-1 NRAQ/NRAQ7
(1) – The maximum distance depends of: number of devices connected, type of cabling, noises, etc		Typology Classification File Number	Open Type device Industrial Control Equipment E352854

INSTALLATION INSTRUCTIONS

The DAT 3580-USB is suitable for fitting to DIN rails in the vertical position. For optimum operation and long life follow these instructions:

When the devices are installed side by side it may be necessary to separate them by at least 5 mm in the following case:

- If panel temperature exceeds 45°C and high power supply value(> 27 Vdc).


Make sure that sufficient air flow is provided for the device avoiding to place raceways or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel.

Install the device in a place without vibrations.

8

Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters, etc...) and to use shielded cable for connecting signals.


CABLING

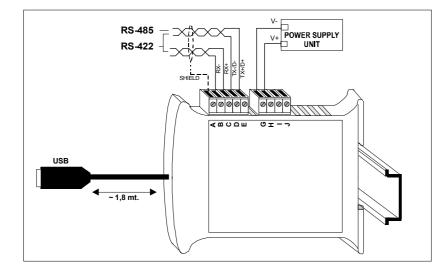

LIGHT SIGNALLING

LED	COLOUR	STATE	DESCRIPTION	
PWR	GREEN	ON	Device powered	
		OFF	Device not powered	
ТХ	RED	RAPID BLINK	Data transmission from the USB port (the blink frequency depends to the baud-rate)	
		OFF	No communication in progress	
RX	RED	RAPID BLINK	Data reception on the RS485/422 port (the blink frequency depends to the baud-rate)	
		OFF	No communication in progress	



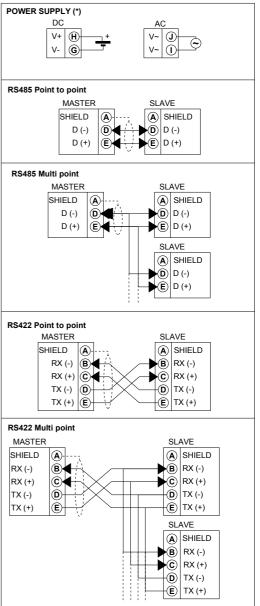

(*) Note: for UL installation the device must be powered using a power supply unit classified NEC class 2 or SELV

