

**FEATURES**

- Interface Ethernet 10/100 Base-T, Modbus TCP Server
- N.16 Digital inputs
- Built-in Web server to acquire the digital inputs state via web browser
- Remotely programmable
- Connection by removable screw-terminals
- LED signalling for Link/Act Ethernet, power supply
- LED signalling for digital inputs state
- Galvanic isolation on all the ways
- UL / CE / UKCA mark
- In compliance to EN-50022 DIN rail mounting



**GENERAL DESCRIPTION**

The device DAT8148 is a Modbus TCP server unit with 16 digital input channels. For the digital inputs are available up to 4 counters 32 bit with measure of frequency up to 300 Hz. The Ethernet interface allows to read and write in real time the value of device's internal registers.

The built-in Web Server allows the remote visualization and acquisition of the digital inputs state and access to and configure the main Ethernet parameters via web browser. The device is also configurable by the software *Dev9K*, a free IDE developed by DATEXEL. The device realizes a full electrical isolation between the lines, introducing a valid protection against the effects of all ground loops eventually existing in industrial applications. The LEDs of signalling of Ethernet activity, input and power supply allow a direct monitoring of the system functionality. The connection is made by removable screw-terminals (inputs and power supply) and RJ45 plug (Ethernet). The DAT8148 is in compliance with the Directive UL 61010-1 for US market and with the Directive CSA C22.2 No 61010-1 for the Canadian market. The device is housed in a rough self-extinguishing plastic enclosure which, thanks to its thin profile of 22.5 mm only, allows a high density mounting on EN-50022 standard DIN rail.

**USER INSTRUCTIONS**

Before to install the device, please read the "Installation Instruction" section. To configure the device use the INIT modality. Connect the terminal INIT to the terminal -V (refer to the User Guide of the device). Connect power supply, Ethernet and digital inputs as shown in the "Wiring" section. The LEDs state depends on the working condition of the device: see the "Light Signalling" section to verify the device working state. To perform configuration and calibration operations, read the instructions in the User Guide of the device. To simplify handling or replacing of the device, it is possible to remove the wired terminals even with the device powered.

**TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in the nominal conditions)**

DIGITAL INPUTS (WET CONTACTS)	ETHERNET INTERFACE	GENERAL SPECIFICATIONS
Channels Input voltage (bipolar) OFF state ON state Impedance Sample time	<b>In compliance with Ethernet IEEE 802.3</b>  <b>Network interface Protocol</b> <b>Max. cable length</b> <b>Number of socket</b>	Power supply voltage Reverse polarity protection Current Consumption
Number of counters Counters register bit-length Counters frequency Minimum pulse width	Ethernet 10/100Base-T Modbus TCP 100 meters 16	<b>ISOLATION (test time : 1 minute)</b> Power Supply / Ethernet Inputs / Power supply Inputs / Ethernet Input / Input
		<b>ENVIRONMENTAL CONDITIONS</b> Operative Temperature UL Operative Temperature Storage Temperature Humidity (not condensed) Maximum Altitude Installation Category of installation Pollution Degree
		<b>CONNECTIONS</b> Ethernet Inputs Power Supply
		<b>MECHANICAL SPECIFICATIONS</b> Material IP Code Wiring  Tightening Torque Mounting Weight
		<b>EMC ( for industrial environments )</b> Immunity Emission <b>UKCA (ref S.I. 2016 N°1091 )</b> Immunity Emission <b>UL</b> US Standard Canadian Standard CCN Typology Classification File Number

## INSTALLATION INSTRUCTIONS

The device is suitable for fitting to DIN rails in vertical position.

For optimum operation and long life follow these instructions:

**When the devices are installed side by side it is necessary to separate them by at least:**

- 10 mm if the UL certification is required.

- 5 mm if the UL certification is not required.

Make sure that sufficient air flow is provided for the device avoiding to place raceways or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel.


Install the device in a place without vibrations.

Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters, etc...) and to use shielded cable for connecting signals.


## LIGHT SIGNALLING

LED	COLOUR	STATE	DESCRIPTION
PWR	GREEN	ON	Device powered
		OFF	Device not powered
		BLINK	Watchdog alarm
STS	YELLOW	OFF	Device in RUN modality
		BLINK	Device in INIT modality
In	RED	ON	Digital Inputs High Level (1)
		OFF	Digital Inputs Low Level (0)

## ISOLATION STRUCTURE

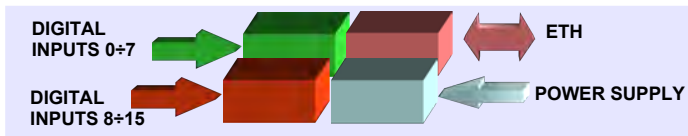


## MECHANICAL DIMENSIONS (mm)

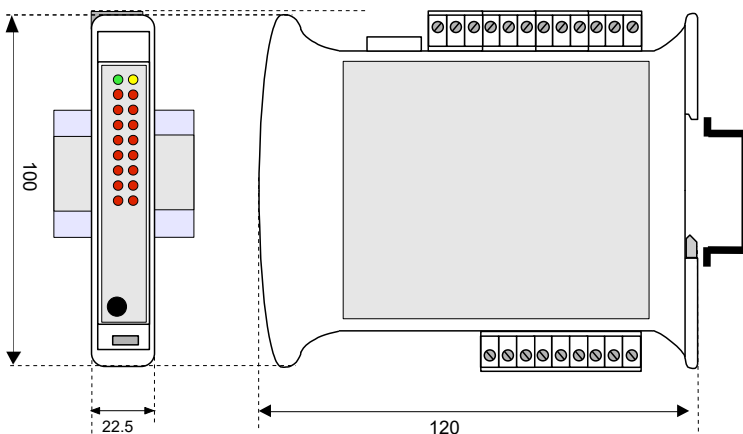


## WIRING

### POWER SUPPLY(\*)

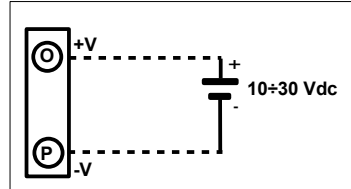



### INIT

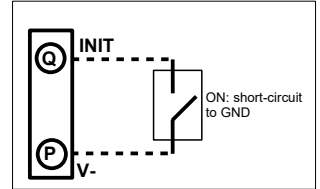



(\*) Note: for UL installation the device must be powered using a power supply unit classified NEC class 2 or SELV and Limited Energy

### DIGITAL INPUTS

#### GROUP DIGITAL INPUTS 0÷7

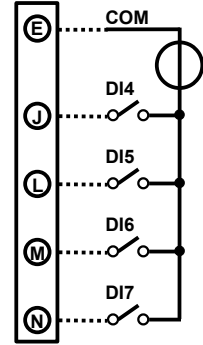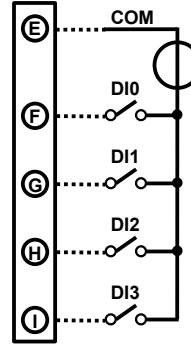

#### GROUP DIGITAL INPUTS 8÷15

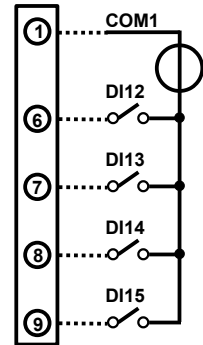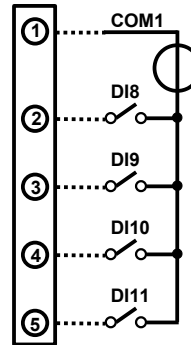

#### NOTES:

the input channels from 0 to 7 are not isolated between them .  
the input channels from 8 to 15 are not isolated between them .  
The group of input channels 0÷7 is isolated from the group of input channels 8÷15.

## MAPPING MODBUS REGISTERS

Register Position	Description	Access
40002	Firmware [0]	RO
40003	Firmware [1]	RO
40004	Name [0]	R/W
40005	Name [1]	R/W
40007	Node ID	R/W
40011	System Flags	R/W
40013	Watchdog timer	R/W
40032	Digital Inputs	RO
40033	Digital Inputs Rise Latch	R/W
40034	Digital Inputs Fall Latch	R/W
40035	Freq. Digital Input 0	RO
40036	Freq. Digital Input 1	RO
40037	Freq. Digital Input 2	RO
40038	Freq. Digital Input 3	RO
40039	32 bit Counter Digital Input 0	R/W
40041	32 bit Counter Digital Input 1	R/W
40043	32 bit Counter Digital Input 2	R/W
40045	32 bit Counter Digital Input 3	R/W

## HOW TO ORDER

“ DAT 8148 “

Note: the device is provided with default configuration as:

IP address : 192.168.1.100

Modbus address: 1



The symbol reported on the product indicates that the product itself must not be considered as a domestic waste. It must be brought to the authorized recycle plant for the recycling of electrical and electronic waste. For more information contact the proper office in the user's city , the service for the waste treatment or the supplier from which the product has been purchased.