

### Modbus TCP Digital IO

### FEATURES

- Interface Ethernet 10/100 Base-T, Modbus TCP Server
- N.8 Digital inputs
- N.4 Relay outputs (SPDT)
- Built-in Web server to acquire the digital inputs state and drive the digital outputs via web browser
- Remotely programmable
- Connection by removable screw-terminals - LED signalling for Link/Act Ethernet, power supply
- LED signalling for digital inputs and outputs state
- Galvanic isolation on all the ways
- UL / CE / UKCA mark
- In compliance to EN-50022 DIN rail mounting

**DAT 8130** 

### **GENERAL DESCRIPTION**

The device DAT8130 is a Modbus TCP server unit with 8 digital input channels and 4 relay outputs type SPDT.

For the digital inputs are available up to four 32 bit counters with measure of frequency up to 300 Hz. The Ethernet interface allows to read and write in real time the value of device's internal registers. The built-in Web Server allows the remote visualization and acquisition of the digital inputs state, to drive the relay outputs and access to and configure the main Ethernet parameters via web browser. The device is also configurable by the software Dev9K, a free IDE developed by DATEXEL. The device realizes a full electrical isolation between the lines, introducing a valid protection against the effects of all ground loops eventually existing in industrial applications. The LEDs of signalling of Ethernet activity, input, output state and power supply allow a direct monitoring of the system functionality. The connection is made by removable screw-terminals (inputs, outputs and power supply) and RJ45 plug (Ethernet).

The DAT8130 is in compliance with the Directive UL 61010-1 for US market and with the Directive CSA C22.2 No 61010-1 for the Canadian market.

The device is housed in a rough self-extinguishing plastic enclosure which, thanks to its thin profile of 22.5 mm only, allows a high density mounting on EN-50022 standard DIN rail.

### **USER INSTRUCTIONS**

Before to install the device, please read the "Installation Instruction" section. To configure the device use the INIT modality. Connect the terminal INIT to the terminal -V (refer to the User Guide of the device). Connect power supply, Ethernet, digital inputs and relay outputs as shown in the "Wiring" section. The LEDs state depends on the working condition of the device: see the "Light Signalling" section to verify the device working state. To perform configuration and calibration operations, read the instructions in the User Guide of the device.

To simplify handling or replacing of the device, it is possible to remove the wired terminals even with the device powered.

TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in the nominal conditions) DIGITAL INPUTS (WET CONTACTS) **ETHERNET INTERFACE GENERAL SPECIFICATIONS** Power supply voltage 10 .. 30 Vdc In compliance with Ethernet IEEE 802.3 Channels 8 60 Vdc max Reverse polarity protection Input voltage (bipolar) Network interface Ethernet 10/100Base-Current Consumption 290 mA max OFF state 0 ÷ 3 V Protocol Modbus TCP ISOLATION (test time : 1 minute) 10 ÷ 30 V ON state Power Supply / Ethernet Max. cable length 1500 Vac, 50 Hz 100 meters Impedance 4.7 KΩ Number of socket Inputs / Power supply 1500 Vac, 50 Hz 16 Sample time 5 ms Inputs / Ethernet 1500 Vac, 50 Hz 1500 Vac, 50 Hz Input / Output Number of counters 4 ENVIRONMENTAL CONDITIONS Counters register bit-length 32 bit up to 300 Hz -10°C .. +60°C Counters frequency Operative Temperature -10°C .. +40°C Minimum pulse width 1 ms UL Operative Temperature Storage Temperature -40°C .. +85°C **DIGITAL OUTPUT** Humidity (not condensed) 0..90% Maximum Altitude 2000 m Channels 4 Installation Indoor Category of installation Pollution Degree Ш Type SPDT relay 2 CONNECTIONS Max. switching power with resistive load per Ethernet RJ-45 (on side) contact Inputs / Outputs Screw terminal block 2 A @ 250 Vac Power Supply Screw terminal block 2 A @ 30 Vdc Max. voltage: MECHANICAL SPECIFICATIONS 250Vac(50/60Hz) Self-extinguish plastic Material IP Code 30Vdc IP20 Wiring wires with diameter 0.8÷2.1 mm<sup>2</sup> / Dielectric strength between contacts 1000 Vac. 50 Hz. AWG 14-18 1 min. **Tightening Torque** 0.5 N m Mounting in compliance with DIN rail standard EN-50022 Dielectric strength between coil and contacts 4000 Vac, 50 Hz, about 190 g Weight 1 min EMC (for industrial environments) EN 61000-6-2 Immunity Emission EN 61000-6-4 UKCA (ref S.I. 2016 N°1091 ) Immunity BS EN 61000-6-2 Emission BS EN 61000-6-4 UL US Standard UL 61010-1 Canadian Standard CSA C22.2 No 61010-1 CCN NRAQ/NRAQ7 Typology Open Type device Classification Industrial Control Fauipment File Number E352854



# INSTALLATION INSTRUCTIONS

The device is suitable for fitting to DIN rails in vertical position. For optimum operation and long life follow these instructions:

When the devices are installed side by side it is necessary to separate them by at least:

### - 10 mm if the UL certification is required.

- 5 mm if the UL certification is not required.

Make sure that sufficient air flow is provided for the device avoiding to place raceways or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel.

Install the device in a place without vibrations.


Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters, etc...) and to use shielded cable for connecting signals.

### **LIGHT SIGNALLING**

LED	COLOUR	STATE	DESCRIPTION
PWR	GREEN	ON	Device powered
		OFF	Device not powered
		BLINK	Watchdog alarm
STS	YELLOW	OFF	Device in RUN modality
		BLINK	Device in INIT modality
l n	RED	ON	Digital Inputs High Level (1)
		OFF	Digital Inputs Low Level (0)
O n	RED	ON	Digital Outputs High Level (1)
		OFF	Digital Outputs Low Level (0)



# MECHANICAL DIMENSIONS (mm)

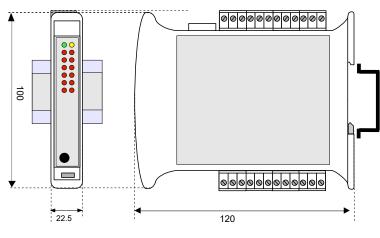


The symbol reported on the product indicates that the product itself must not be considered as a domestic waste. It must be brought to the authorized recycle plant for the recycling of electrical and


electronic waste. For more information contact the proper office in the user's city , the service for the waste treatment or the supplier from which the product has been purchased.


# $\frac{\text{WIRING}}{\text{POWER SUPPLY(*)}}$ INIT $\boxed{\bigcirc + V \\ \hline - V \\ \hline$

(\*) Note: for UL installation the device must be powered using a power supply unit classified NEC class 2 or SELV and Limited Energy DIGITAL INPUTS

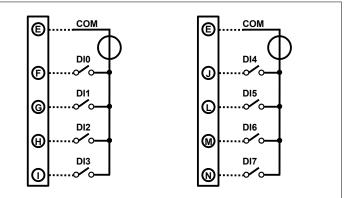

NOTE: the input channels are not isolated between them RELAY OUTPUTS





## MAPPING MODBUS REGISTERS

Register Position	Description	Access
40002	Firmware [0]	RO
40003	Firmware [1]	RO
40004	Name [0]	R/W
40005	Name [1]	R/W
40007	Node ID	R/W
40011	System Flags	R/W
40012	Power Up / Safe	R/W
40013	Watchdog timer	R/W
40031	Digital Outputs	R/W
40032	Digital Inputs	RO
40033	Digital Inputs Rise Latch	R/W
40034	Digital Inputs Fall Latch	R/W
40035	Freq. Digital Input 0	RO
40036	Freq. Digital Input 1	RO
40037	Freq. Digital Input 2	RO
40038	Freq. Digital Input 3	RO
40039	32 bit Counter Digital Input 0	R/W
40041	32 bit Counter Digital Input 1	R/W
40043	32 bit Counter Digital Input 2	R/W
40045	32 bit Counter Digital Input 3	R/W

### HOW TO ORDER

### " DAT 8130 "

Note: the device is provided with default configuration as: IP address : 192.168.1.100 Modbus address: 1

Datexel s.r.l. reserves its right to modify the characteristics of its products totally or in part without warning at any time.

### ED.05.19 REV.09